


- NOTES:
1. THE BUILDING SHALL HAVE A NEW DEDICATED FIRE ALARM CONTROL PANEL (FACP) LOCATED IN THE BASEMENT SERVING ALL THE UNITS. THIS FACP SHALL BE ADDRESSABLE TYPE.
  2. ALL SMOKE DETECTORS SHALL BE SYSTEM TYPE CONNECTED TO THE NEW FACP.
  3. NEW FLOW AND TAMPER SWITCHES SHALL BE CONNECTED TO THE NEW FACP. VERIFY LOCATION AND QUANTITY OF DEVICES WITH SPRINKLER CONTRACTOR PRIOR TO ROUGH-IN.
  4. THE EC SHALL CONFIRM ALL ATTRIBUTES OF THE PROPOSED FIRE ALARM SYSTEM WITH THE LOCAL FIRE DEPARTMENT PRIOR TO STARTING CONSTRUCTION.
  5. NOT USED
  6. EC TO PROVIDE 2-2"FC FOR TELECOM AND FIRE ALARM SERVICES. THESE CONDUITS ARE TO ORIGINATE IN THE MAIN ELECTRICAL ROOM IN THE BASEMENT AND STUB UP IN THE RETAIL SPACES. EC TO PROOVE ELECTRICAL PANELS, CONFIRM ALL CONDUIT AND ELECTRICAL PANEL LOCATIONS WITH ARCHITECT PRIOR TO ROUGH IN.

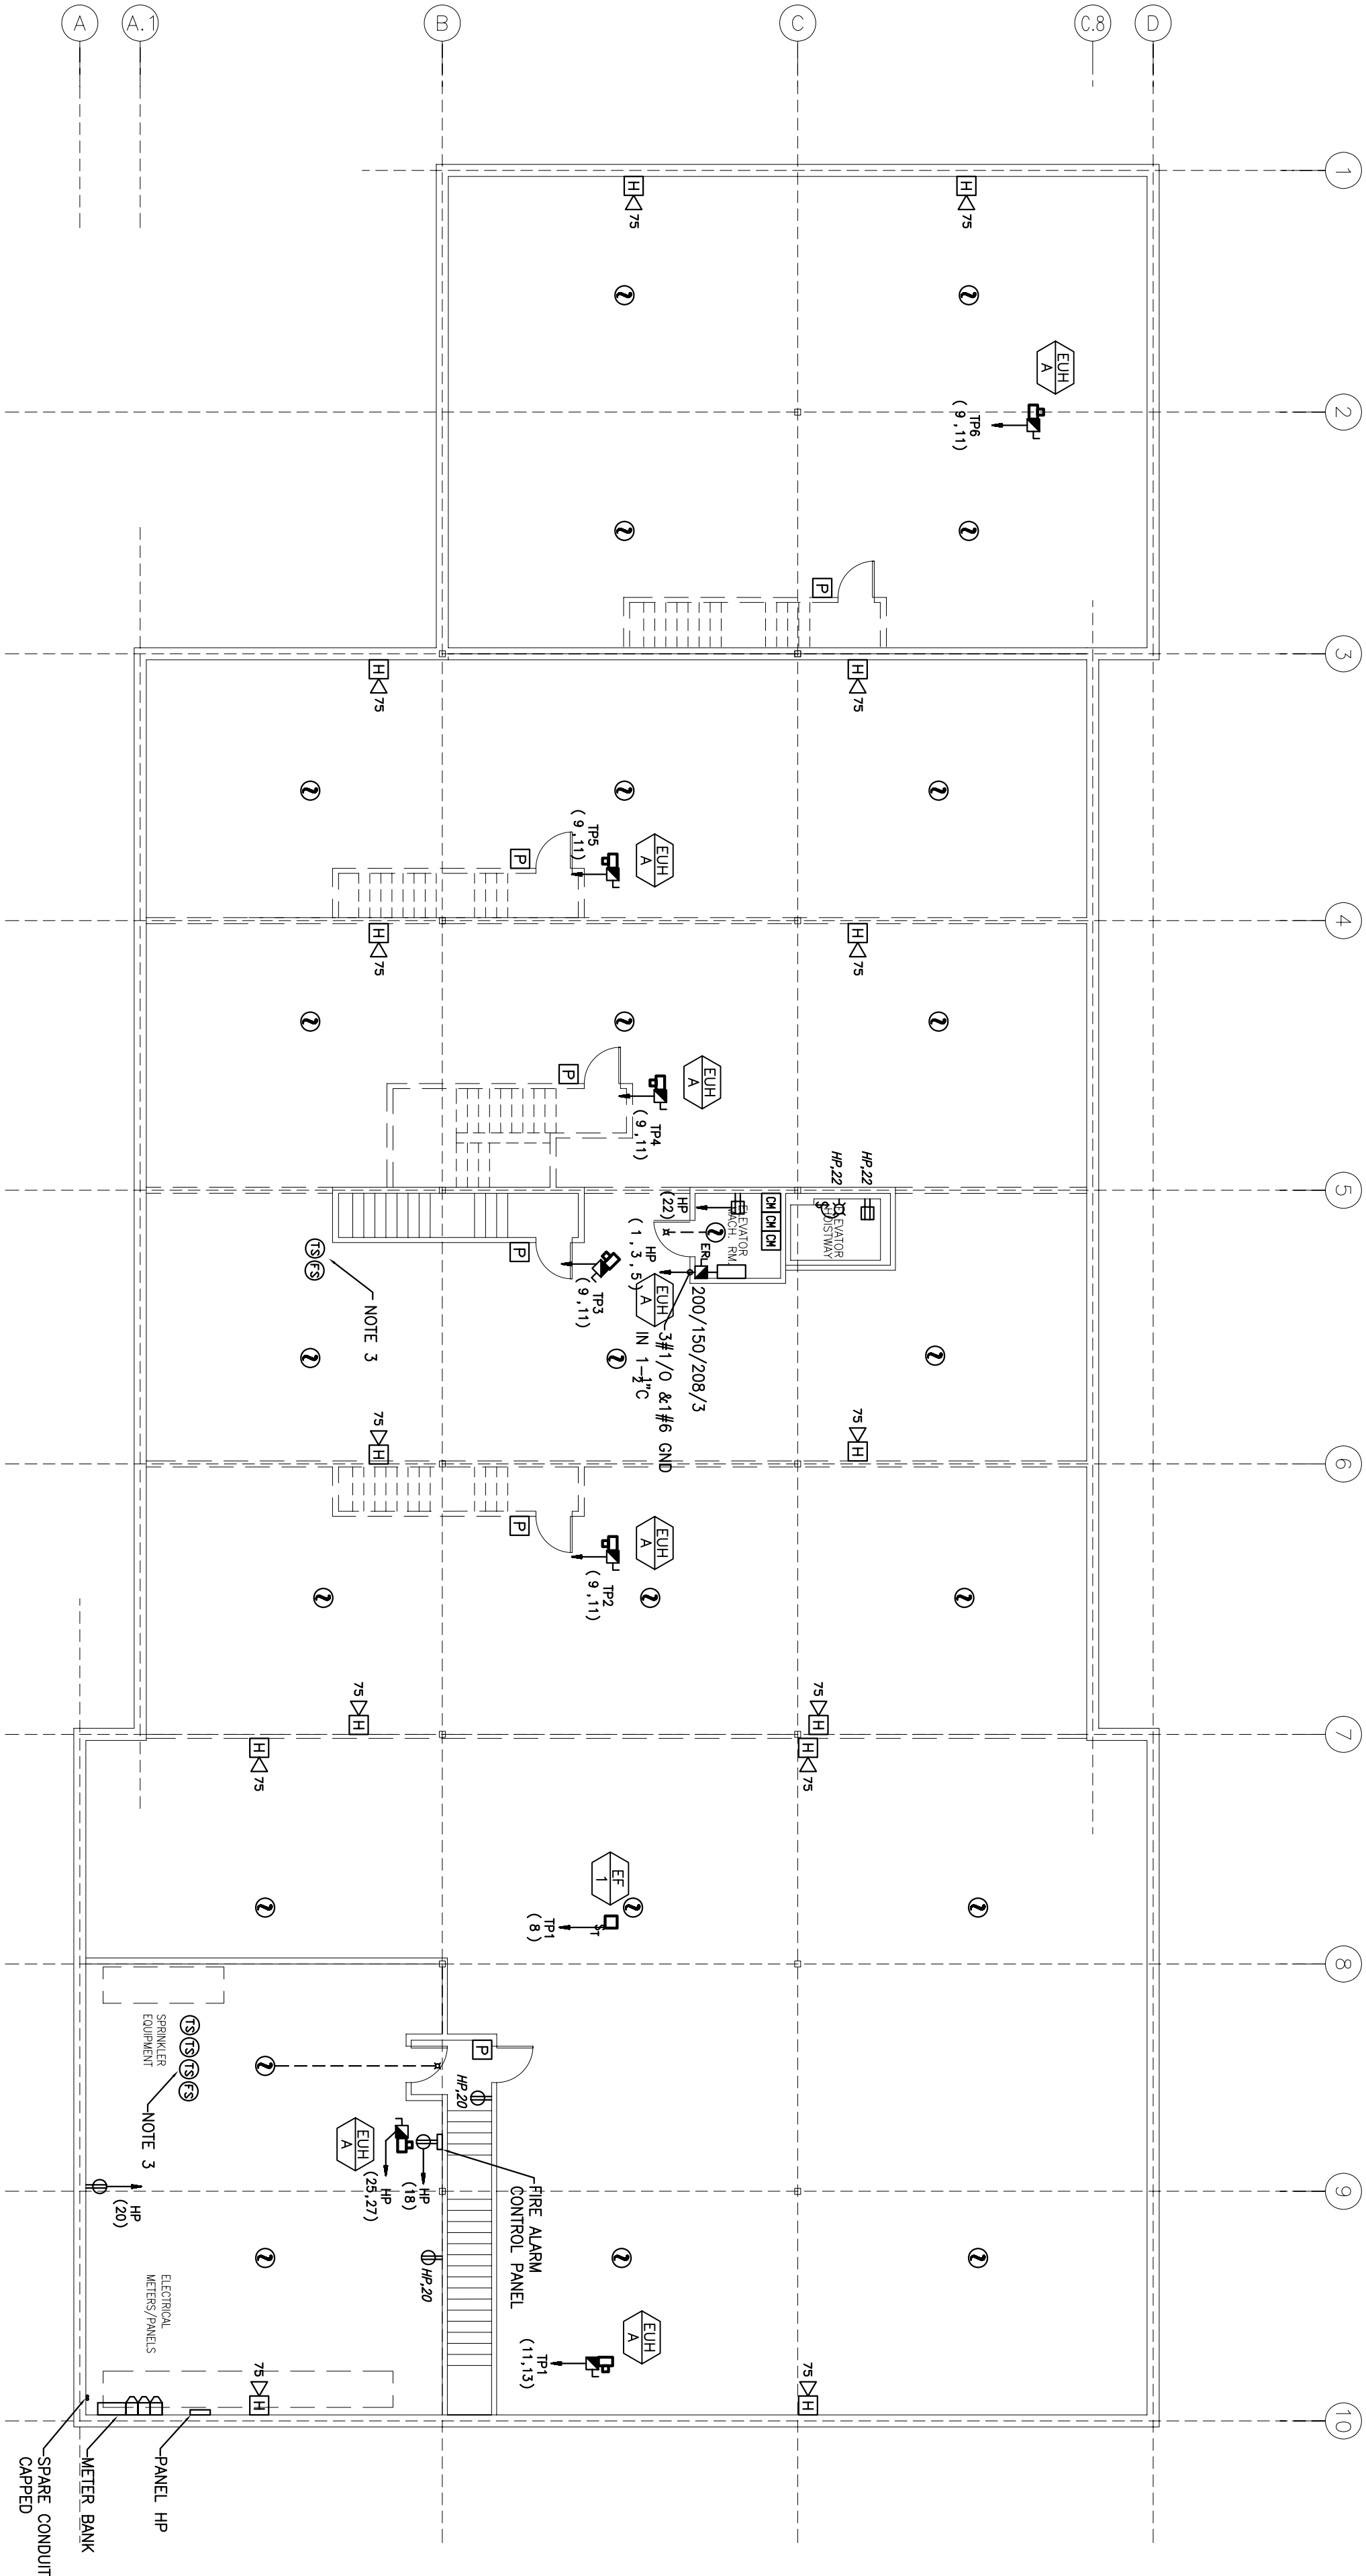

The Village  
Shoppes of  
North Reading  
303 Main Street  
North Reading, MA

Permit

No.	ISSUE	DATE
1	PERMIT SET	5/30/08


PROJECT #:  
28112

DRAWING TITLE:  
BASEMENT POWER PLAN

E1.0